
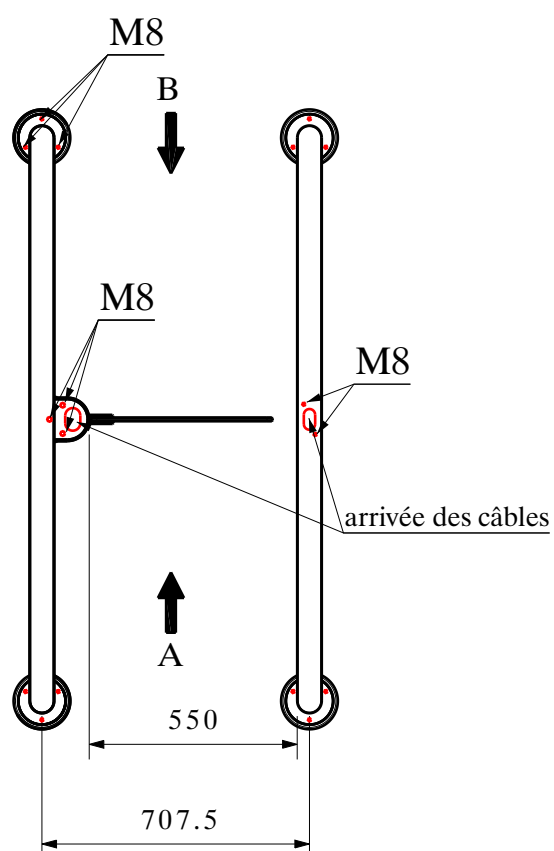
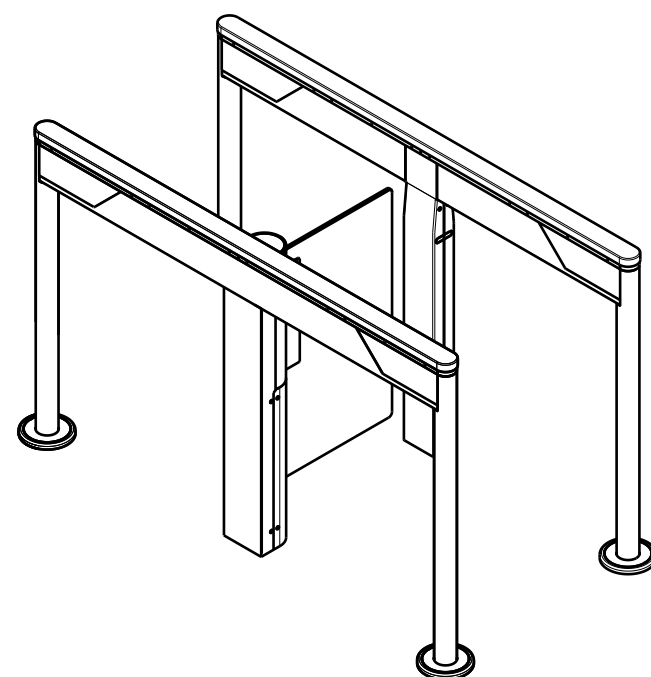
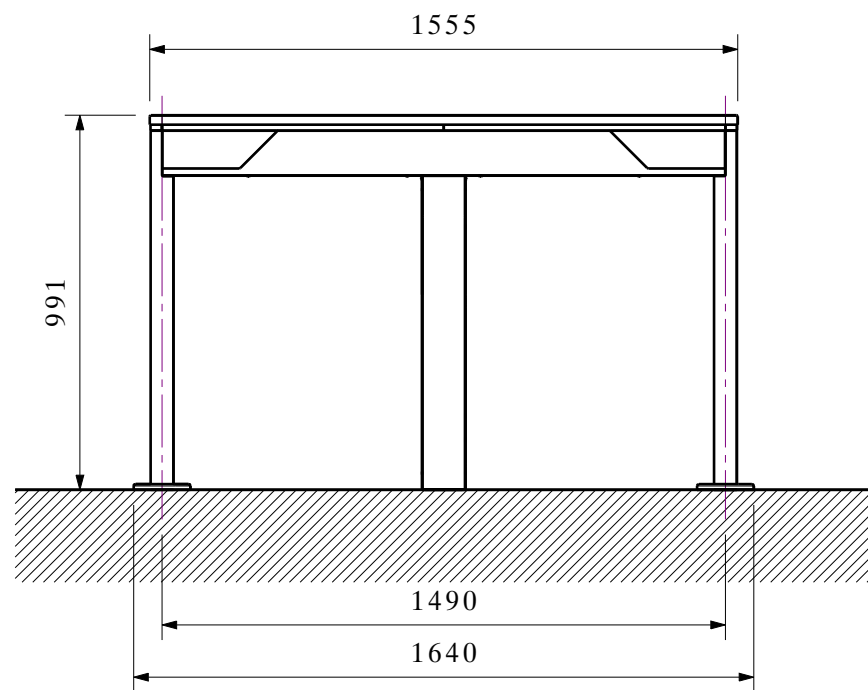


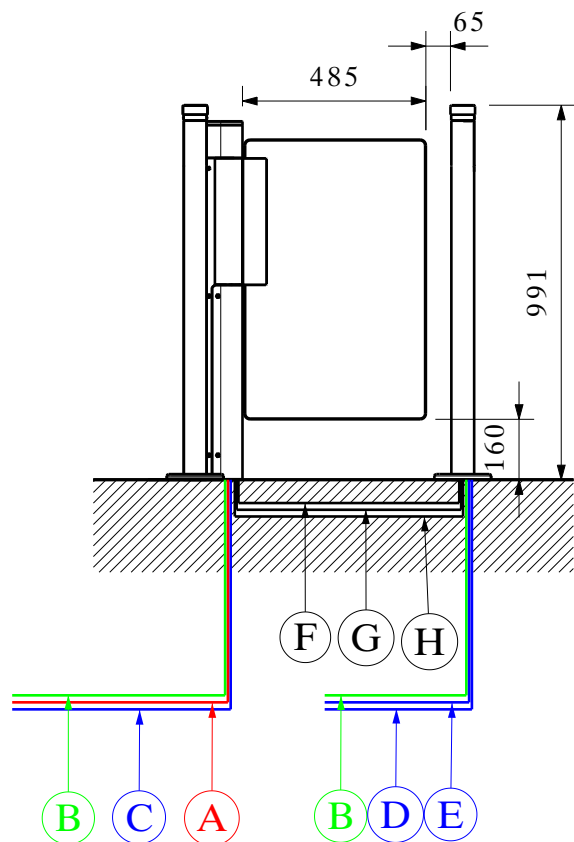

Cables to be provided by the client:

- (A) Mains power (230VAC) cable: 3G2.5²
- (B) Card reader cable (to access control system)
- (C) Ethernet cable: CAT5
- (D) Card reader cable (from access control system)
- (E) Alarm/evacuation cable: LIYY 2x0.25²


Cables provided by Automatic Systems:

- (F) 24VDC control cable (intra-equipment): LIYCY 2x0.75²
- (G) Groud/earth wire (intra-equipment): 2.5²
- (H) CAN cable (intra-equipment) LIYCY (STP): 2x2x0.25² (max.10m)

CAUTION:

To prevent drilling into the conduits, maintain them 115 mm under the finished floor level

PVC conduit Ø30mm (MAX.)
Coring : Ø50

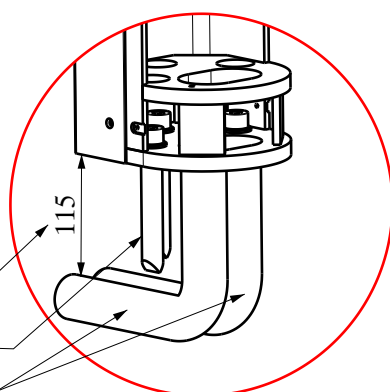

FIXING :

Use the chemical sealing

Drill Ø14 & 100mm deep for M8

Note:

In any case, 3m tail cable end must be foreseen
Foresee wiring harnesses between each unit

TEMPLATE : GBR-E-7204

DESIGNATION :
BESTEMMING :

SlimLane 944

Ce plan est notre propriété et ne peut être cédé à des tiers ni être recopié sans autorisation écrite de Automatic Systems.
Dit plan blijft onze eigendom en mag niet voorgelegd aan derden noch worden gekopieerd zonder schriftelijke toelating van Automatic Systems.

AUTOMATIC
SYSTEMS
BAR GROUP

Avenue Mercator. 5 - B-1300 Wavre
www.automatic-systems.com

DESSINE :
GETEKEND :

CF

DATE :
DATUM :

22/07/2014

N° DOSSIER :
N° DOSSIER :

VERIFIE :
NAGEZIEN :

MEL

ECHELLE :
SCHAAL :

1/20

PLAN N° :
PLAN N° :

CH8381-gb

B

Les dimensions sont données
en mm.
De afmetingen zijn gegeven in
mm.

Ne pas mesurer sur le plan.
Niet meten op het plan.